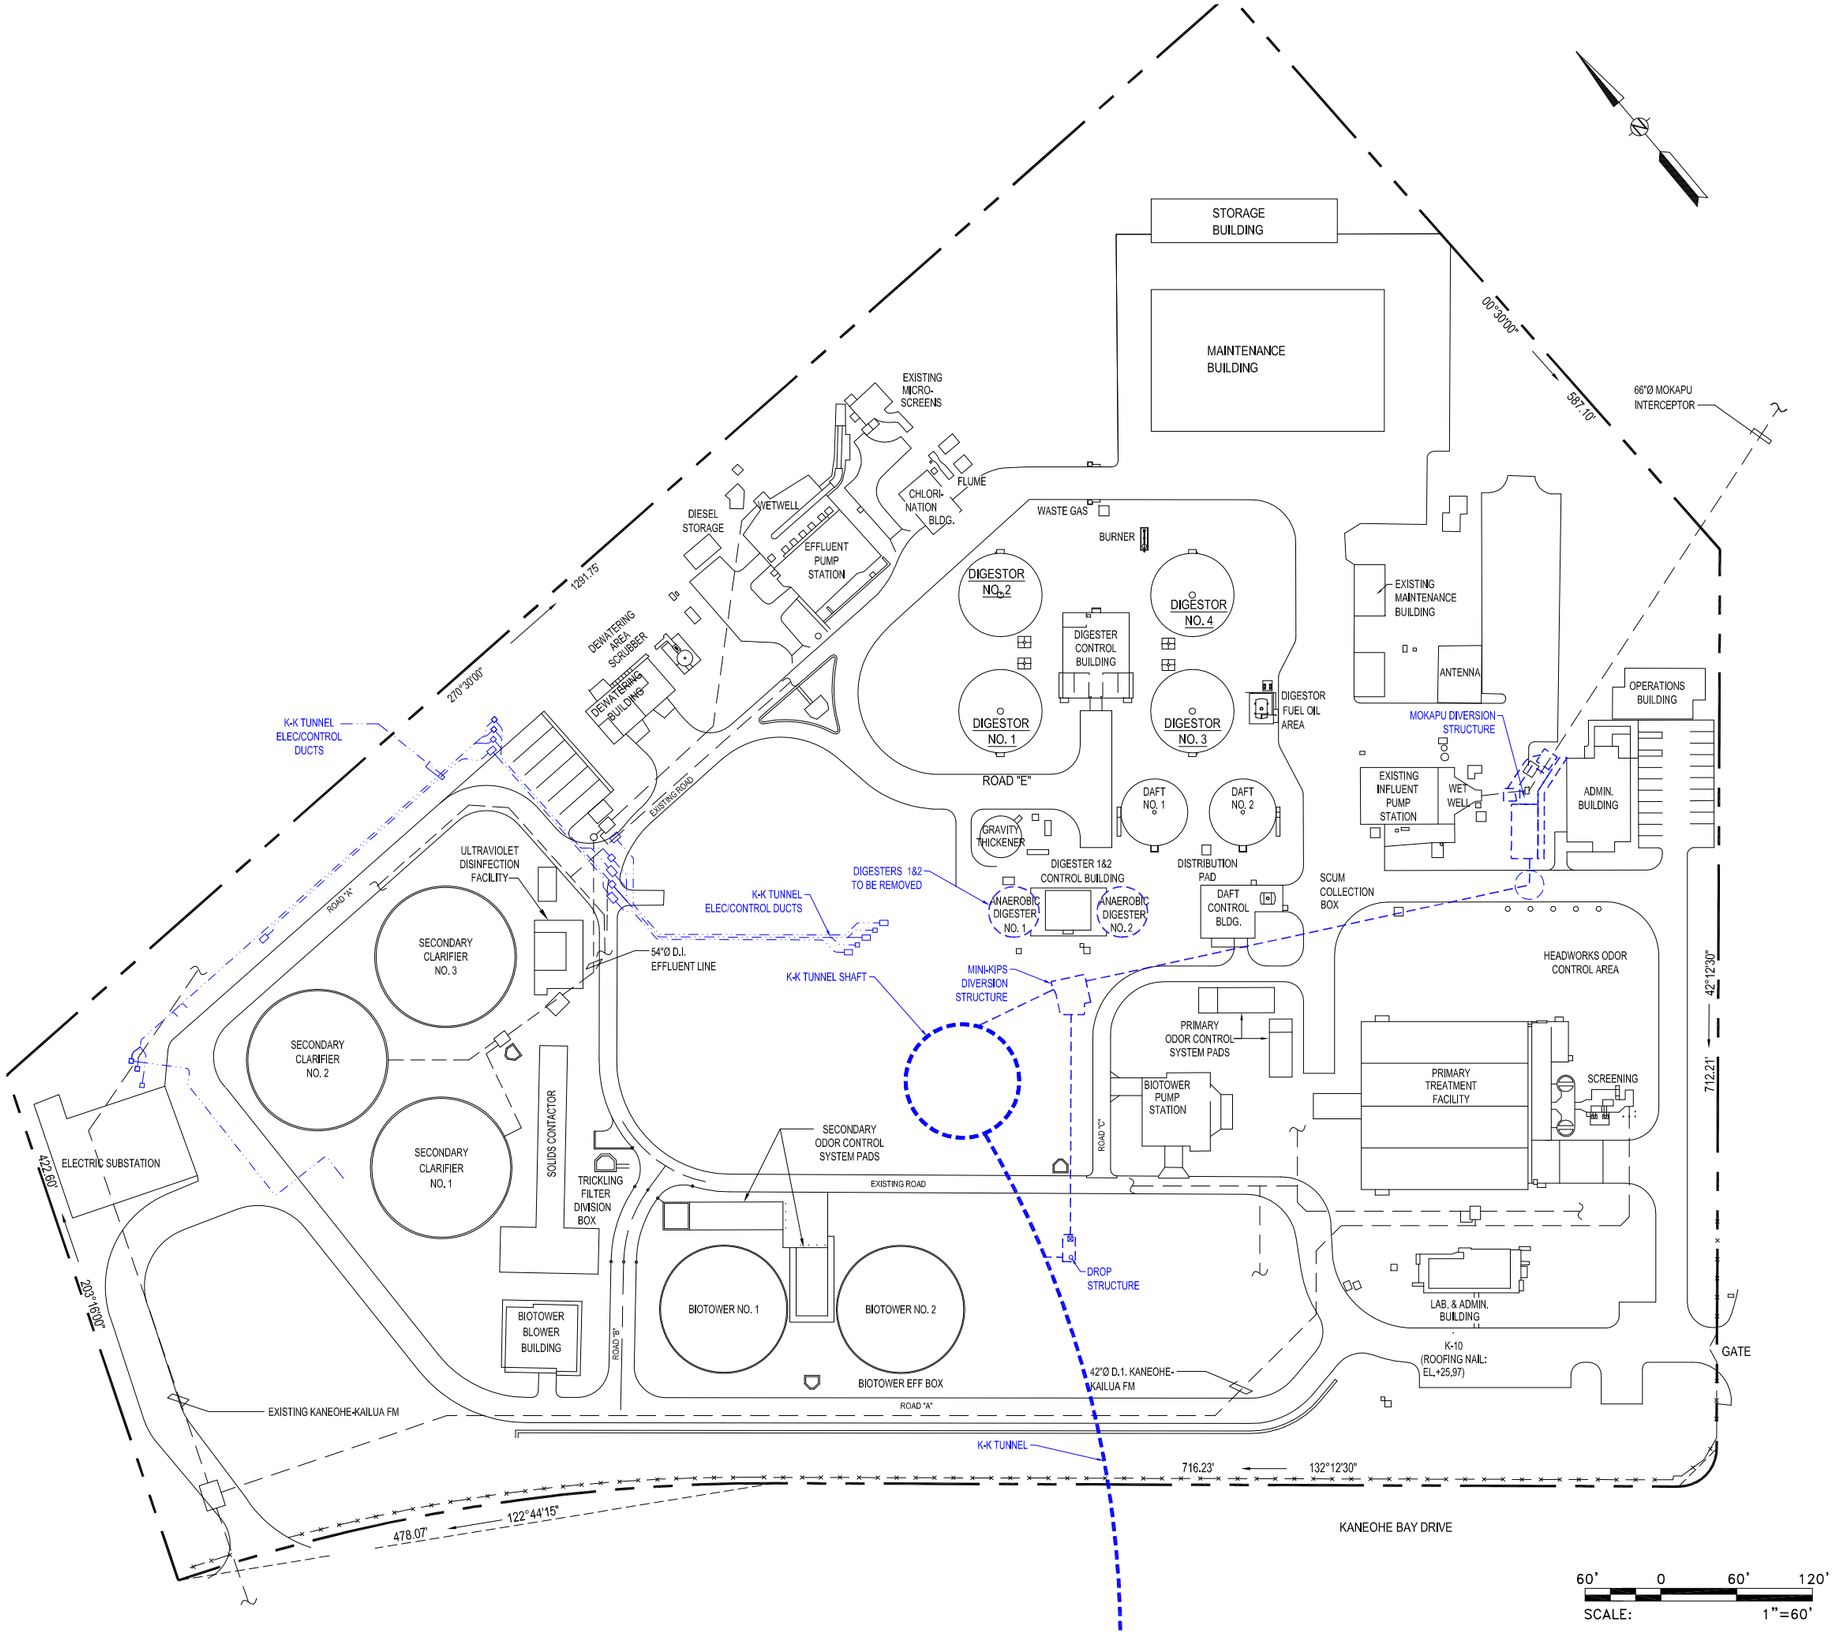
STORAGE BUILDING
MAINTENANCE BUILDING
00°30'00"
587.10'
66"Ø MOKAPU INTERCEPTOR
EXISTING MICRO-SCREENS
FLUME
CHLORI-NATION BLDG.
WETWELL
DIESEL STORAGE
EFFLUENT PUMP STATION
1291.75'
270°30'00"
DEWATERING AREA SCRUBBER
DEWATERING BUILDING
K-K TUNNEL ELEC/CONTROL DUCTS
EXISTING ROAD
WASTE GAS
BURNER
DIGESTOR NO. 2
DIGESTOR NO. 4
DIGESTER CONTROL BUILDING
DIGESTOR NO. 1
DIGESTOR NO. 3
DIGESTOR FUEL OIL AREA
ROAD "E"
EXISTING MAINTENANCE BUILDING
ANTENNA
OPERATIONS BUILDING
MOKAPU DIVERSION STRUCTURE
EXISTING INFLUENT PUMP STATION
WET WELL
ADMIN. BUILDING
GRAVITY THICKENER
DAFT NO. 1
DAFT NO. 2
DIGESTER 1&2 CONTROL BUILDING
DISTRIBUTION PAD
DIGESTERS 1&2 TO BE REMOVED
ANAEROBIC DIGESTER NO. 1
ANAEROBIC DIGESTER NO. 2
DAFT CONTROL BLDG.
SCUM COLLECTION BOX
K-K TUNNEL ELEC/CONTROL DUCTS
ULTRAVIOLET DISINFECTION FACILITY
ROAD "A"
SECONDARY CLARIFIER NO. 3
54"Ø D.I. EFFLUENT LINE
K-K TUNNEL SHAFT
MINI-KIPS DIVERSION STRUCTURE
HEADWORKS ODOR CONTROL AREA
42°12'30"
712.21'
PRIMARY ODOR CONTROL SYSTEM PADS
SECONDARY CLARIFIER NO. 2
BIOTOWER PUMP STATION
PRIMARY TREATMENT FACILITY
SCREENING
ROAD "C"
SECONDARY CLARIFIER NO. 1
SOLIDS CONTACTOR
ELECTRIC SUBSTATION
422.60'
SECONDARY ODOR CONTROL SYSTEM PADS
TRICKLING FILTER DIVISION BOX
EXISTING ROAD
DROP STRUCTURE
203°16'00"
BIOTOWER BLOWER BUILDING
ROAD "B"
BIOTOWER NO. 1
BIOTOWER NO. 2
LAB. & ADMIN. BUILDING
K-10 (ROOFING NAIL: EL.+25.97)
GATE
BIOTOWER EFF BOX
42"Ø D.I. KANEOHE-KAILUA FM
ROAD "A"
EXISTING KANEOHE-KAILUA FM
K-K TUNNEL
716.23'
132°12'30"
122°44'15"
478.07'
KANEOHE BAY DRIVE
60' 0 60' 120'
SCALE: 1"=60'